


**NOTE:**

ENCASE ALL BURIED METALLIC SURFACES WITH POLYETHYLENE WRAP (8 MIL. MIN.) AS SPECIFIED IN A.W.W.A. C105.

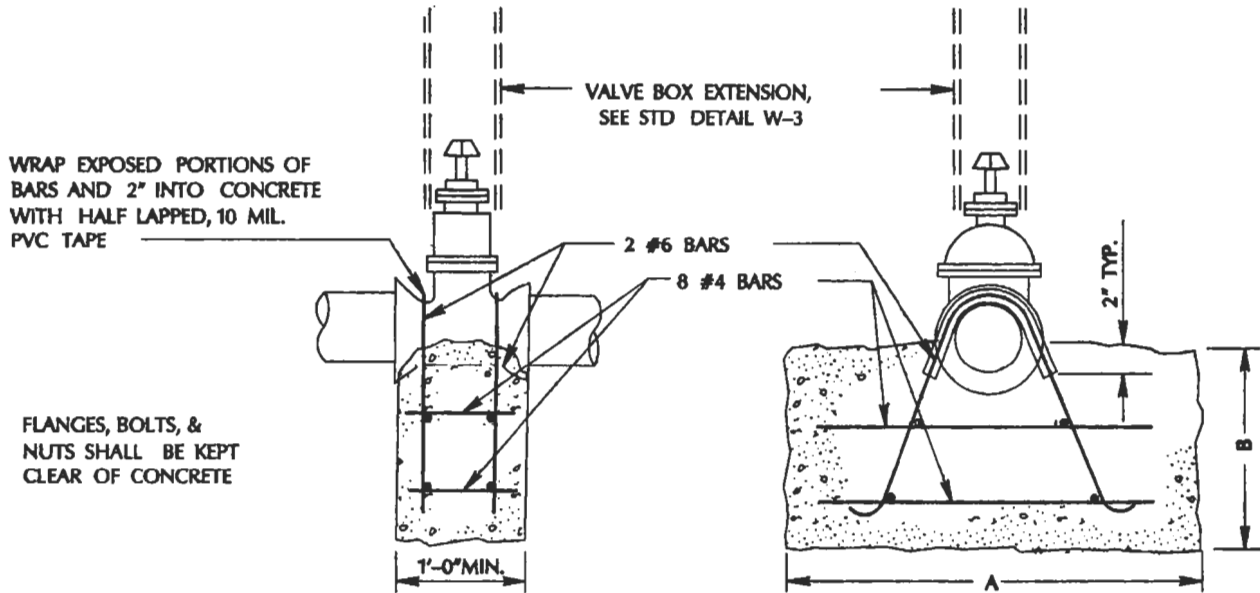

SIZE OF GATE VALVE	ANCHOR BLOCK DIMENSIONS (FT.)		
	A	B	
		200 PSI TEST	250 PSI TEST
3"	1.5	1.5	2.0
4"	2.0	1.5	2.0
6"	3.0	1.5	2.0
8"	3.0	1.5	2.0
10"	3.0	2.0	2.5
12"	3.5	2.0	2.5

APPROVED BY

*[Signature]*

DATE

*[Signature]*

## VALVE ANCHOR BLOCKS

DEPARTMENT OF PUBLIC WORKS



DRAWING NO.

W-4